



Owner's manual

ECOFLO[®]

Compact biofilter



Certified
to NSF/ANSI
standard
40 & 245



Certified
to CAN/BNQ
standard
3680-600



Certified
to BNQ
standard
NQ 3680-910

**IF YOU NEED ASSISTANCE, PLEASE CALL PREMIER TECH WITH
YOUR ECOFLO COMPACT BIOFILTER MODEL* :**

**Your septic plan or your designer can provide this information.*

TABLE OF CONTENTS

PREAMBLE	3
1. Operating principle	3
1.1 Primary treatment	3
1.2 Advanced secondary treatment	3
1.3 Polishing treatment	3
2. Operating guidelines	4
2.1 Start-up warranty	5
2.2 Owner's responsibility	5
2.3 About the air vent of your home	5
3. Maintenance	6
3.1 Primary treatment	6
3.2 Effluent filter	6
3.3 Ecoflo compact biofilter	6
4. Ecoflo biofilter with pump	7
4.1 Visual and audio alarm system	7
4.2 Electrical connections	8
5. What to do in case of... ..	8
5.1 An activated alarm	8
5.2 A prolonged power failure	8
5.3 Flooding	8
5.4 Backflow	8
5.5 Odors	8
Appendix 1 Certificate of warranty for the Ecoflo compact biofilter	10
Appendix 2 Ecoflo compact biofilter models	12
Appendix 3 Installation diagrams	14
Appendix 4 Notice of change of property ownership	15

Owner's manual |

Ecoflo® compact biofilter — Canada | USA

Congratulations on purchasing the **Ecoflo compact biofilter**!

Here at Premier Tech Water and Environment, we are passionate about protecting our water sources and preserving our planet for future generations. When you choose the Ecoflo compact biofilter, you are choosing to help us make that difference!

This manual contains information on the operation, operation guidelines, maintenance, and warranties on your Ecoflo compact biofilter.

1. OPERATING PRINCIPLE

On-site wastewater treatment systems must respect applicable local rules and regulations. These systems are specifically designed to treat residential wastewater to such a level that treated effluent can be safely returned to the environment. Typically, an on-site wastewater treatment system is composed of two to three main treatment steps depending on site conditions: primary treatment, treatment system, and, if required, polishing treatment.

1.1 PRIMARY TREATMENT

The primary/septic tank is the primary treatment. It clarifies wastewater by letting suspended solids settle to the bottom and retaining floating matter to prevent premature clogging of the treatment system. It is strongly recommended that the primary/septic tank be equipped with an effluent filter. Every primary/septic tank and effluent filter shall be installed according to local regulations.

For more information on the operation, operating guidelines, maintenance, and warranties of Premier Tech primary/septic tanks with effluent filters, please refer to these systems' owner's manuals, which can be found at PT-WaterEnvironment.com.

1.2 ADVANCED SECONDARY TREATMENT

Once wastewater has passed through the primary/septic tank, it flows toward the Ecoflo compact biofilter. Inside the biofilter, a tipping bucket disperses the wastewater onto specially designed plates, which, in turn, evenly distributes the wastewater onto the filtering medium. The wastewater then trickles through the natural filtering medium. The treated effluent can then be discharged to the environment in accordance to local regulations.

The Ecoflo compact biofilter's operating principle allows the system to be used continuously or intermittently without requiring any special precaution or having any impact on the quality of the treatment. In most cases, no specific action from the owner is required to start the system.

The model and the number of Ecoflo compact biofilter are determined by the domestic wastewater flow per day. The selection of the model also depends on the available surface area, the topography of the site, as well as the type, permeability, and depth of the natural soil on site.

1.3 POLISHING TREATMENT

When required, the Ecoflo compact biofilter can be combined with Premier Tech's disinfection filter (FDi), UV disinfection unit (DiUV), nitrogen reduction unit (ECDn), or phosphorus removal unit (DpEC) to reduce pathogen concentrations or phosphorus.

For more information on the operation, operating guidelines, maintenance, and warranties of Premier Tech's FDi, DiUV, ECDn, and DpEC systems, please refer to their respective owner's manuals, which can be found at PT-WaterEnvironment.com.

2. OPERATING GUIDELINES

Type of wastewater that can be treated by the Ecoflo compact biofilter: Domestic wastewater (for example, wastewater from isolated dwellings).

Never discharge the following products into sinks, toilets, or directly into your septic system:

- oil and grease (motor oil, cooking oil, etc.)
- wax and resins
- paints and solvents
- any kind of petroleum product
- any kind of pesticide
- any kind of septic tank additive
- anything not easily biodegradable (for example, coffee beans, cigarette butts, sanitary napkins, tampons, condoms, cotton swabs, etc.)
- pharmaceutical products
- cleaners for pipes or pipelines
- any kind of toxic substance
- household cleaning products that are unsafe for your septic system



Premier Tech Water and Environment strongly recommends the following precautions:

- NEVER open or go inside the primary/septic tank or the Ecoflo biofilter.
- Keep all lids of the septic system accessible at all times. Never cover them with mulch, dirt, or any permanent structure (patio, swing set, shed, etc.). Otherwise, the service partner will be unable to conduct your annual maintenance.
- Once landscaping is complete, your septic installation's lids must exceed the final soil surface by 2" (50 mm) and must respect the minimum distances for Ecoflo compact biofilter lids (see table on the next page). Ensure that runoff water flows away from the lids to reduce the risk of infiltration into the system.
- ONLY install Premier Tech peripherals and accessories, including risers.
- NEVER install a riser on a fiberglass open-bottom or polyethylene Ecoflo compact biofilter unit with a separate pumping vault access. This could damage the unit because of excess weight and void your warranty.
- NEVER install more than one extra 6" (150 mm) riser on a polyethylene Ecoflo compact biofilter with only a main access. Failure to follow these recommendations could damage the unit, create a dangerously confined space for the service partner during annual maintenance, and void your warranty.
- NEVER install more than one riser on a concrete Ecoflo compact biofilter unit. This could create a dangerous confined space for the service partner during annual maintenance and void your warranty.
- NEVER plant trees within 9' 10" (3 m) of the fiberglass Ecoflo compact biofilter lid or within 6' 6" (2 m) of the absorption bed. Tree roots could grow and damage your septic installation.
- NEVER have a drain pipe, roof gutter, sump pump, or air conditioner drain connected to the septic system.
- NEVER discharge content or water from a water softener, spa, or pool into your septic system.
- NEVER discharge wastewater from a recreational vehicle (camping trailer, caravan, etc.) into any of the components of your septic system.
- NEVER use automatic toilet bowl cleaners.

- ALWAYS keep the lid of the Ecoflo compact biofilter free of any accumulated debris and away from any accumulation of snow, backfill, landscaping material, rocks, or the bottom of a slope, an embankment, or retaining wall, etc. **See the minimum distances to respect in table below.** Failure to respect these distances may damage the unit and void its warranty.

Minimum distances from Ecoflo compact biofilter lids

Shell type	Distance to respect to the lids
Fiberglass	16' 5" (5 m)
Polyethylene	13' 1" (4 m)
Concrete	9' 10" (3 m)

- NEVER drive a vehicle or place objects weighing more than 500 lb (225 kg) too close of the lid of your Ecoflo compact biofilter. If you are planning any kind of landscaping or property work (snow removal, lawn mowing, excavation, etc.), **make sure you advise all those involved**, so they do not damage your septic system. It is recommended to note where your septic system elements are located.

By respecting these guidelines, you contribute to the proper operation of your septic system and help prolong the life of your Ecoflo compact biofilter filtering medium. Failure to abide by these guidelines may, at Premier Tech's discretion, render the warranty invalid.

2.1 START-UP WARRANTY

The system's warranty begins upon purchase. Should the start-up be delayed, it is the customer's responsibility to inform Premier Tech about it so the first maintenance, which is included in the purchase price, is postponed. If the first maintenance has been performed prior to the client's call, Premier Tech reserves the right to decide whether another maintenance, free of charge or not, will be carried out the following year. No request for delayed start-up will be accepted any later than one year after the purchase date without it affecting the product's warranties.

2.2 OWNER'S RESPONSIBILITY

The owner must respect all existing laws and regulations regarding the system's effluent quality and its discharge into the environment. Make sure to check with your local regulators your requirements regarding the operation and maintenance of your system.

As a complement to your installation, the Ecoflo biofilter team offers annual maintenance. By maintaining the filtering medium of your Ecoflo compact biofilter every year, you contribute to ensure the long life of your system, saving you from having to replace the filter prematurely. This visit is also associated with the warranty of your installation. Most septic systems must be maintained annually as part of local environmental regulations.

2.3 ABOUT THE AIR VENT OF YOUR HOME

Your home must be equipped with an air vent that is in proper working condition. All plumbing must comply with applicable building code standards in your location. Every septic tank must be ventilated by an air duct with a diameter of at least 4" (100 mm) or be connected to the air vent of the isolated dwelling being served. Premier Tech strongly recommends using a pipe with a diameter of 4" (100 mm) for the air vent.

Any change in the use of your home or any modification to your Ecoflo compact biofilter must be authorized by local authorities, and Premier Tech must be advised. Failure to meet this requirement may result in voiding your warranty.

3. MAINTENANCE

3.1 PRIMARY/SEPTIC TANK

Your primary/septic tank should be pumped out every two to four years, or whenever the level of sludge measured exceeds the total height of water in the tank by two-thirds. This helps maintain your septic system's performance. Every primary/ septic tank and effluent filter shall be inspected and maintained as prescribed by local regulations. Any local service provider is qualified to perform this procedure.

Residential garbage disposal units or sewage pumps can increase the accumulation of sludge in your septic tank. If your home is equipped with one of these, Premier Tech strongly recommends emptying your primary/septic tank more frequently.

To have complete records of maintenance performed on your septic system, we recommend keeping any invoices within the owner's manual as proof of maintenance.

IMPORTANT: Primary/septic tanks can be emptied in several ways that can be classified into two categories: complete emptying and selective emptying.

Complete emptying is the process of completely pumping the contents of the primary/septic tank. If performed properly, the primary/septic tank will be completely empty when the vacuum truck leaves the site. If you have a plastic primary/septic tank, make sure to fill it with water once the emptying and maintenance (if required) is complete.

Selective emptying is divided into two sub-categories: with a filter (or recycled) and without a filter. The method with a filter requires a specialized truck that separates solids from wastewater and retains them. The mechanically-clarified water is then returned to the primary/septic tank. The selective method without a filter allows the solids to settle inside the truck before the water is returned to the primary/septic tank. As such, to ensure the Ecoflo compact biofilter continues to perform optimally, it is very important to ensure that the water returned to the primary/septic tank has been properly clarified and contain very little or no suspended solids.

3.2 EFFLUENT FILTER

Under normal operating conditions, as described in this manual, an effluent filter that complies with local regulations should operate efficiently for many years. It must be cleaned every time the primary/septic tank is emptied, as established or recommended by local authorities. A service partner can do this during the annual maintenance.

3.3 ECOFLO COMPACT BIOFILTER



The owner of an The owner of the Ecoflo compact biofilter **shall follow the manufacturer's recommendations regarding the maintenance of the system.** For that purpose, the owner must at all times have a valid contract with the manufacturer or its local representative, and, depending on local regulations, **a copy of the contract may have to be filed with local authorities.**

Annual maintenance is important to ensure optimal performance of your Ecoflo compact biofilter and essential to maintain its warranty. Therefore, your system must be serviced annually for the duration of its life cycle.

Annual maintenance is performed by a Premier Tech local network partner or by a qualified third party. The service includes a visual inspection of all components, a test of the system's treatment performance, and maintenance of the filtering medium to maximize its lifespan. **Please ensure that your system's lid is easily accessible for maintenance.** Never cover or bury the Ecoflo compact biofilter's lid. After each inspection, you will be given a maintenance record. We recommend that you keep it in this manual. To obtain the detailed maintenance report, please contact Premier Tech.

At the end of its normal life span, the filtering medium is analyzed by one of our authorized agents. If the filtering medium is in proper condition and the operating guidelines have been respected, it may be possible to use the filtering medium for an additional year before having it refurbished. **However, your Ecoflo compact biofilter's filtering medium must be refurbished before the system's treatment capacity and performance begin to deteriorate.** The filtering medium can be easily pumped out by a vacuum truck designed to empty septic tanks. The new filtering medium is then installed by an authorized agent.

We also recommend contacting Premier Tech to be referred to a local partners. The local partner will provide a maintenance adapted to your needs and that preserves the Ecoflo compact biofilter. To know more about the maintenance of your Ecoflo compact biofilter, refer to your maintenance agreement. For help or more information, please contact Premier Tech Water and Environment at 1 800 632-6356 or visit our website at PT-WaterEnvironment.com.

4. ECOFLO COMPACT BIOFILTER WITH PUMP

Some Ecoflo compact biofilter models have an integrated pumping station (other situations may require a separate pumping station), that directs treated effluent to an appropriate disposal area. Electro-mechanical components are included in this system.

4.1 VISUAL AND AUDIO ALARM SYSTEM



Pumping station alarm box

The pumping station is equipped with a high-water level float connected to an alarm system. This alarm system must be installed inside the residence.

The alarm activates along with a red light when the water level in the Ecoflo compact biofilter is unusually high. If the alarm activates, contact Premier Tech at the number inscribed on the panel. We offer a 24/7 service. This incident must be dealt with promptly. To turn off the alarm, press the **"SILENCE"** button.

The **"TEST"** button lets you check if the alarm system is working properly. During a test, you should see the red indicator light up and hear the alarm.

In the event of a power failure, the alarm system continues to function on an emergency 9 V alkaline battery (not supplied). Using a rechargeable battery is not recommended.

NOTE: Replace the emergency battery every 12 months, each time the alarm is activated, or whenever there is a power failure. If the battery is weak, the system will beep once every minute. Replace the battery immediately when this occurs.


To replace the 9 V battery:

- Disconnect the alarm box and remove it from the wall (the battery must be inserted on the side of the box).
- Open the cover of the 9 V battery compartment and replace the battery with a 9 V alkaline battery.
- Close the cover, reinstall the box on the wall, and reconnect it.
- If the alarm is activated, press the **"RESET/TEST"** button to initialize it.

4.2 ELECTRICAL CONNECTIONS

All electrical connections must be done by a **certified electrician**. Using seal connectors is mandatory. Premier Tech recommends installing the power box on top of the pumping station's insulating board to avoid any issues with humidity.

Use two separate circuit-breakers, one to operate the pump and the other to connect the alarm box. Do not connect anything else to these circuit-breakers (for example, a household appliance). They must be used exclusively for the pump and the alarm box. In the case of commercial, community, institutional, or municipal application, refer to your Premier Tech project manager.

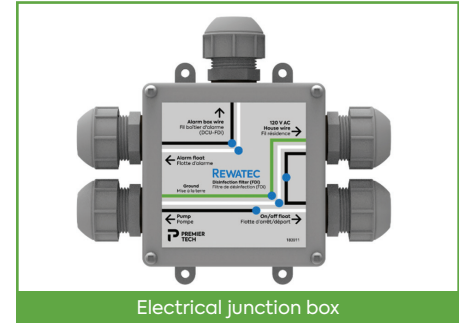

Electrical junction box

5. WHAT TO DO IN CASE OF...



5.1 AN ACTIVATED ALARM

If an alarm is activated unrelated to a power failure, contact Premier Tech so the problem can be identified and corrected.



5.2 A PROLONGED POWER FAILURE

If a winter power failure is prolonged or if you are planning to shut down your system, protect the components of your septic system against freezing.

If one of these situations occurs, or If you have any questions about restarting your system, contact Premier Tech.



5.3 FLOODING

Certain sites are prone to flooding or to rises in groundwater levels. This can lead to a malfunction in your septic system or alter the performance of your Ecoflo compact biofilter. If this happens, contact Premier Tech.



5.4 BACKFLOW

Backflow rarely occurs. If it does, the primary/septic tank is usually the cause. Your primary/septic tank installer or primary/septic tank pumper can typically take care of the situation.



5.5 ODORS

All septic systems are apt to generate gases and odors. The position of the air vent, as well as other factors unrelated to the Ecoflo compact biofilter itself, can prevent septic gases from dispersing properly and lead to odors. If this happens, contact Premier Tech to help identify the problem.

**If you have any questions or comments, do not hesitate
to contact Premier Tech at +1 800 632-6356**



PT Water and Environment

+1 800 632-6356

info.ptwe.na@premiertech.com

PT-WaterEnvironment.com



The information contained in this document was up-to-date and consistent with the information available at the time of publication. Premier Tech Ltd and its affiliated companies make no warranties or representations as to its accuracy. Because of its continuous improvement policy, Premier Tech Ltd and its affiliated companies reserve the right to change and/or discontinue the manufacture of any product and/or modify technical data and prices, for any reason whatsoever and at its sole discretion, without further notice and without liability to anyone in this regard. ECOFLO®, PREMIER TECH® and PREMIER TECH & DESIGN™ are trademarks of Premier Tech Ltd or its affiliates. For current data regarding all patent application(s) and patent(s) for this product or any part thereof, consult the website patentmarking.premiertech.com, with the following references: 1596, 2777, and 8296.

© 2023 Premier Tech Ltd. All rights reserved.

APPENDIX 1 | CERTIFICATE OF WARRANTY FOR THE ECOFLO COMPACT BIOFILTER

1. PREAMBLE

Premier Tech Technologies Ltd. (hereinafter called "Premier Tech") is proud to provide its customers with an exclusive wastewater treatment system guaranteed by an innovative Warranty. For the application and interpretation of this Warranty, "Customer" shall mean the person who has purchased the Ecoflo compact biofilter (hereinafter called "Initial Purchaser"), for a residential installation only, as well as any subsequent purchaser (hereinafter called "Subsequent Purchaser(s)"), in accordance with the provisions of section 8 of this Warranty. "Successor(s)" shall mean any other person entitled to exercise the same rights as the Customer under the law.

For a commercial, community, institutional or municipal installation, please refer to your treatment system warranty provided by your Premier Tech's project manager.

2. NATURE OF THE WARRANTY

2.1 Ecoflo compact biofilter

Premier Tech warrants (parts and labour) to the Customer that the filtering medium of the Ecoflo compact biofilter will work properly – including treatment performance and the absence of clogging and excess sludge that could negatively affect system performance for a period of ten (10) years for EC, EC5, EC7, ST, and STB model series (except ST and STB models with a 100% peat filtering medium that shall function properly for eight (8) years) from the date of purchase by the Initial Purchaser (proof of purchase required).

Premier Tech warrants to the Customer that the filtering medium of the Ecoflo compact biofilter shall function properly – including treatment performance and the absence of clogging and excess sludge that could negatively affect system performance for a period of eight (8) years for ST and STB model series from the date of purchase by the Initial Purchaser (proof of purchase required).

Except as provided in sections 2.2 and 2.3 below, Premier Tech also warrants all parts of the Ecoflo compact biofilter components against any manufacturing defect for a period of ten (10) years from the date of purchase by the Initial Purchaser (proof of purchase required). The first two years of the warranty also cover the labour.

2.2 Concrete

Premier Tech does not offer any additional Warranty on the shell of the concrete Ecoflo compact biofilter. Accordingly, the Customer shall rely on the local concrete manufacturer's Warranty policy.

2.3 Pump, floats, alarm box and junction box

The pump, floats, alarm box and junction box included with the Ecoflo compact biofilter are guaranteed for three (3) years (parts and labor), from the date of purchase by the Initial Purchaser (proof of purchase required).

Premier Tech's conventional Warranty is expressly limited to the text of this Certificate and valid provided the Ecoflo compact biofilter was installed in accordance with applicable regulations and with the manufacturer's recommendations.

3. NOTICE

For this Warranty to be valid, the Customer must notify Premier Tech in writing immediately upon the appearance of any indication of an anomaly or irregularity in the Ecoflo compact biofilter.

Such notice shall be mailed to Premier Tech's Head Office at 1, avenue Premier, Rivière-du-Loup, Québec, G5R 6C1, CANADA, by facsimile at (418) 862-6642 or by email at info.ptwe.na@premiertech.com.

Upon receipt of this notice, Premier Tech shall examine the situation and, if necessary, take appropriate corrective measures in accordance with the terms of this Warranty.

4. GENERAL EXCLUSIONS

The following damages or problems are excluded from the Warranty:

- Any damage or problem caused by a fortuitous event or "force majeure", such as, without limiting the generality of for the ongoing, an earthquake, a flood, frost, hurricane, landslide, explosion or dynamiting;
- Any damage or problem caused by the fault or act of a third party including, without limiting the generality of the foregoing, the execution of landscaping work;

- Any damage or problem arising from a defective installation of the Ecoflo compact biofilter;
- Any damage or problem arising from any installation, modification, correction or addition to the treatment system carried out after installation of the Ecoflo compact biofilter without prior written approval from Premier Tech;
- Any damage or problem caused by the use of a septic tank that does not comply with the applicable regulations and/or with Premier Tech's specifications, as described in the Owner's manual;
- Any damage or problem, if it is shown that the usage of the Ecoflo compact biofilter was not in accordance with the instructions and guidelines described in the Owner's manual;
- Any damage or problem, if the maintenance of the Ecoflo compact biofilter was not carried out by a person authorized by Premier Tech, in accordance with the Maintenance Agreement;
- Any damage or problem caused by an omission or act of the Customer or the Customer's Successors including, without limiting the generality of the foregoing, refusal to allow access to the system for maintenance;
- Any damage or problem, if it is found that the Customer or the Customer's Successors have modified or changed the use of the property serviced by the Ecoflo compact biofilter resulting in the alteration of the nature or quality of wastewater being treated and/or that constitutes a violation of the applicable regulations;
- Any damage or problem caused by and/or resulting from the work carried out to access to the Ecoflo compact biofilter, including, without limiting the generality of the foregoing, excavation, snow removal or demolition;
- Any damage or problem resulting from the condition of the site or of the soil and not reported or not properly reported to Premier Tech by the Customer or the person undertaking the site investigation.

5. PARTICULAR EXCLUSIONS

It is further expressly understood that the Customer may not carry out or cause to be carried out any repair or verification of the Ecoflo compact biofilter sold to him, or attempt to carry out any work or to apply any corrective measures whatsoever to said work, before notifying Premier Tech in accordance with the provisions of section 3 of this Warranty and before Premier Tech has visited the site, within a reasonable time following receipt of said notice, to assess the situation.

If the Customer carries out or causes to be carried out repairs, or attempts to repair or to apply corrective measures of any kind whatsoever to the Ecoflo compact biofilter sold to him without prior authorization by Premier Tech, this Warranty shall be considered null and void and Premier Tech shall be considered completely discharged from any and all of its obligations under this Warranty.

6. INDEMNITIES AND DAMAGES

Subject to the application of the provisions and exclusions provided for in this Warranty, Premier Tech's liability and obligations regarding any corrective measure carried out or any attempt to correct an indicated problem shall be limited to replacing the filtering medium and/or one or several components of the Ecoflo compact biofilter and to supplying the required labour, if applicable.

7. LIMITATION OF LIABILITY

Premier Tech's compensation or indemnification obligation shall be limited to the provisions of section 6 of this Certificate of Warranty and Premier Tech shall not be held liable for any other damage or loss that may have been suffered or incurred by the Customer or any third party in connection with the Ecoflo compact biofilter, its parts and/or components which originate thereof.

No additional warranty, express or implied, hence excluding any direct or indirect consequential damages (not limited to but including third parties loss) concerning the design, sale or use of the Ecoflo compact biofilter and/or services provided by Premier Tech is hereby granted. Premier Tech's liability under its warranty obligation shall in no case exceed the cost of the Ecoflo compact biofilter.

8. TRANSFER OF OWNERSHIP

In the event of transfer of ownership, sale, assignment or disposal in any way whatsoever of the Customer's property to a third party, this Warranty shall continue to apply if and only if the Subsequent Purchaser or the Successor confirms, by forwarding the attached "Notice of New Property Owner" to Premier Tech within a reasonable delay, that he/she is the new owner of the property, he/she understands and is aware of the content of this Certificate of Warranty and accepts its terms and conditions.

The person who proceeds with the transfer, sale, assignment or disposal of any way whatsoever of the property undertakes to hand over to the Subsequent Purchaser or the Successor the Certificate of Warranty provided upon completion of the work, as well as the Owner's manual and, if applicable, the Maintenance and Environmental Monitoring Program for the Ecoflo compact biofilter.

Failure to abide by the terms and conditions of section 8 of this Certificate of Warranty may, at Premier Tech's discretion, render it invalid or to be rejected.

9. INSPECTION

The Customer and/or the Customer's Successors shall allow Premier Tech or its duly authorized representatives to carry out all necessary monitoring and inspections, as required, for implementation of this Warranty.

If the Customer and/or the Customer's Successors notify Premier Tech of an alleged defect or malfunction of the Ecoflo compact biofilter and that, after inspection, it is found that no such defect or malfunction exists or that such defect or malfunction is excluded from or does not apply to the Warranty, a minimum charge of \$200.00 plus direct expenses shall be paid by the Customer and/or the Customer's Successors for the cost of the inspection.

10. INTERPRETATION

The terms and conditions of this Warranty shall be interpreted according to and governed by the provisions of this Warranty and the legislation in effect in the Province of Quebec.

11. PRIORITY OF THE CERTIFICATE OF WARRANTY

This Warranty supersedes any contract or understanding, written or verbal, entered into between the Customer and Premier Tech. In the event of contradiction between this Warranty and any other documents and/or contracts entered into between the Customer and Premier Tech, this Warranty shall prevail.

12. PURCHASERS AND SUCCESSORS

Subject to the provisions of this Warranty and especially those of section 8, this Warranty shall continue to be valid for Subsequent Purchasers and Successors and shall continue to have full effect until the end of the agreed Warranty period provided for in section 2 of this Certificate.

12. PURCHASERS AND SUCCESSORS

Subject to the provisions of this Warranty and especially those of section 8, this Warranty shall continue to be valid for Subsequent Purchasers and Successors and shall continue to have full effect until the end of the agreed Warranty period provided for in section 2 of this Certificate.

APPENDIX 2 | ECOFLO COMPACT BIOFILTER MODELS

The Ecoflo compact biofilter can be found in different model series, which are ST, STB, EC, EC5, and EC7. The model number of the Ecoflo compact biofilter relates to its characteristics, as presented in the following table.

NOTE: Some model series may not be approved in your area.

ST AND STB MODEL SERIES

STB	570	PR																		
Unit and pump: Not mentioned = Fiberglass shell B = Concrete unit with gravity discharge BA = Concrete unit with gravity discharge and ready to use BR = Concrete unit with pump BRA = Concrete unit with pump and ready to use P = Polyethylene unit ready to use PR = Polyethylene unit with pump and ready to use																				
Capacity: USA <table> <tr> <td>500 = 450 US gal/d</td><td>Demand dosed</td><td>Time dosed</td></tr> <tr> <td>570 = 520 US gal/d</td><td>1,600 L/d or 2,000 L/d</td><td></td></tr> <tr> <td>650 = 600 US gal/d</td><td>1,755 L/d or 2,200 L/d</td><td></td></tr> <tr> <td>730 = 680 US gal/d</td><td>2,000 L/d or 2,500 L/d</td><td></td></tr> <tr> <td>750 = 690 US gal/d</td><td>2,250 L/d or 2,810 L/d</td><td></td></tr> <tr> <td></td><td>2,310 L/d or 2,890 L/d</td><td></td></tr> </table> Canada			500 = 450 US gal/d	Demand dosed	Time dosed	570 = 520 US gal/d	1,600 L/d or 2,000 L/d		650 = 600 US gal/d	1,755 L/d or 2,200 L/d		730 = 680 US gal/d	2,000 L/d or 2,500 L/d		750 = 690 US gal/d	2,250 L/d or 2,810 L/d			2,310 L/d or 2,890 L/d	
500 = 450 US gal/d	Demand dosed	Time dosed																		
570 = 520 US gal/d	1,600 L/d or 2,000 L/d																			
650 = 600 US gal/d	1,755 L/d or 2,200 L/d																			
730 = 680 US gal/d	2,000 L/d or 2,500 L/d																			
750 = 690 US gal/d	2,250 L/d or 2,810 L/d																			
	2,310 L/d or 2,890 L/d																			

Discharge method:

ST = Open or perforated bottom (infiltration under the biofilter)

STB = Watertight bottom (gravity or pumped discharge)

Example:

STB-570PR refers to a polyethylene ready-to-use Ecoflo compact biofilter unit with a watertight bottom. This model is designed for 332 US gal/d (1,260 L/d) or three bedrooms.

EC5 MODEL SERIES

(maximum applicable HLR 500 L/m² per day or 12.25 US gal/ft² per day)

EC	C	500	P	DV	PACK	USA
Territory: CAN = Canada: flow in L/d USA = United States: flow in US gal/d						
Configuration: PACK = Single-unit configuration No mention = Stand-alone biofilter						
DV = Dosing volume						
Discharge method: G = Gravity O = Open bottom (perforated) P = With integrated pump						
Capacity: 370 US gal/d or 1,400 L/d 400 US gal/d or 1,500 L/d 450 US gal/d or 1,700 L/d 500 US gal/d or 2,050 L/d 640 US gal/d or 2,400 L/d 750 US gal/d or 2,800 L/d 860 US gal/d or 3,200 L/d 970 US gal/d or 3,600 L/d						

Unit:

C = Concrete
 F = Fiberglass
 P = Polyethylene

EC = Ecoflo with coconut husk fragment filter

Example:

ECC-500-P (PACK) refers to an Ecoflo system with a filtering medium made of coconut husk fragments. The unit is made of polyethylene, the daily flow capacity is 500 US gal/d (2,050 L/d), there is an integrated pump, the bottom of the unit is watertight, and the primary/septic tank and biofilter are combined in a single-unit configuration.

EC7 MODEL SERIES

(maximum applicable HLR 700 L/m²d or 17.2 gal/ft²d)

EC7	600	P	P	DV	PACK	USA
-----	-----	---	---	----	------	-----

Territory:

CAN = Canada: flow in L/d

USA = United States: flow in US gal/d

Configuration:

PACK = Single-unit configuration

No mention = Stand-alone biofilter

DV = Dosing volume

Discharge method:

G = Gravity

O = Open bottom (perforated)

P = With integrated pump

Shell:

C = Concrete

F = Fiberglass

P = Polyethylene

Capacity:

500 US gal/d or 1,900 L/d

600 US gal/d or 2,200 L/d

750 US gal/d or 2,800 L/d

800 US gal/d or 3,000 L/d

900 US gal/d or 3,400 L/d

1050 US gal/d or 4,000 L/d

1200 US gal/d or 4,500 L/d

1350 US gal/d or 5,000 L/d


EC = with coconut husk fragment filter

Example:

EC7-600-P-P-PACK refers to an Ecoflo system with a filtering medium made of coconut husk fragments. The unit is made of polyethylene, the daily flow capacity is 600 US gal/d (2,200 L/d), there is an integrated pump, the bottom of the unit is watertight, and the primary/septic tank and biofilter are combined in one monobloc configuration.

APPENDIX 3 | INSTALLATION DIAGRAMS

ECOFLO COMPACT BIOFILTER WITH ABSORPTION BED

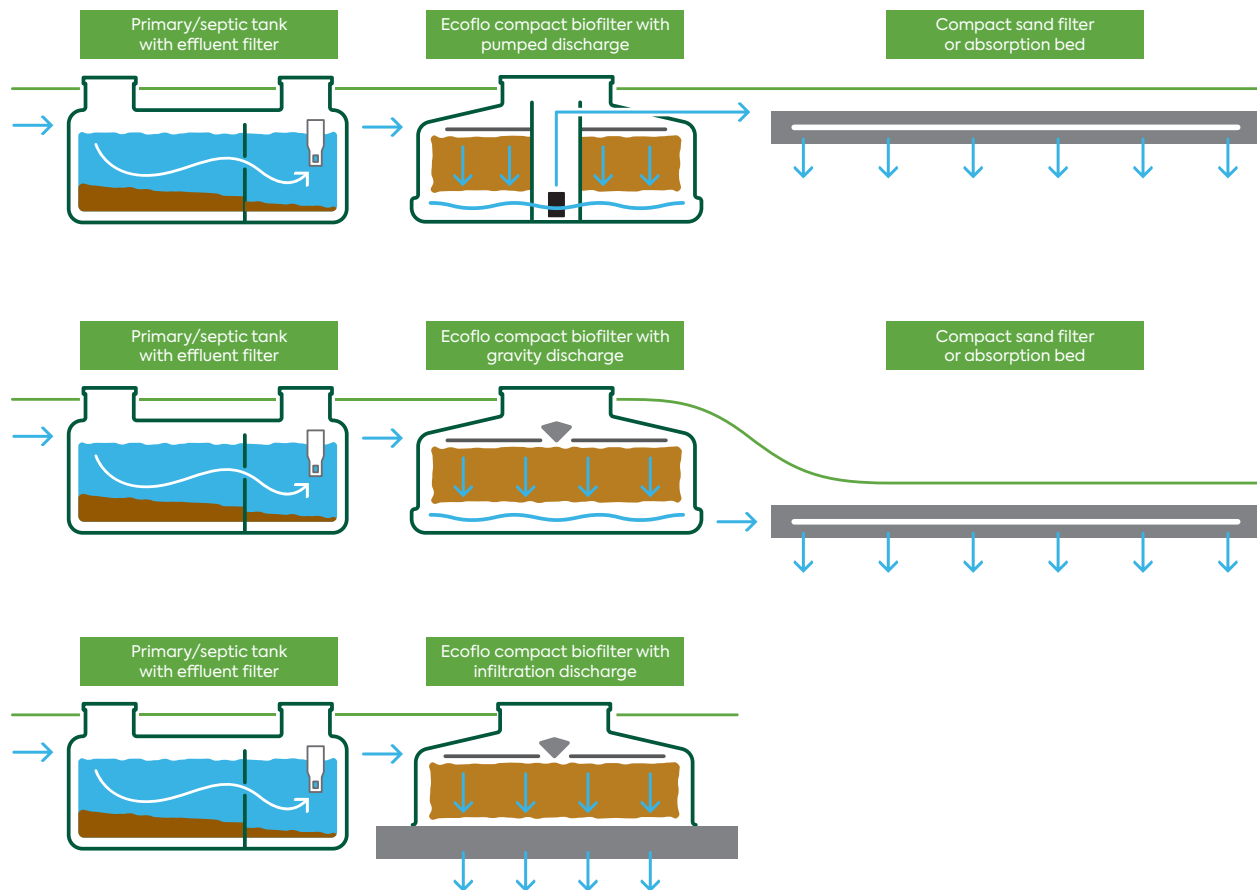

APPENDIX 4 | NOTICE OF OWNERSHIP CHANGE

THIS FORM MUST BE RETURNED TO PREMIER TECH WATER AND ENVIRONMENT

1, Premier avenue, Premier Tech Campus, Rivière-du-Loup, Quebec G5R 6C1
or info.ptwe.na@premiertech.com

Have you recently sold or purchased a property where wastewater was treated by a Premier Tech system? Please complete the information below to the best of your knowledge to ensure a quick and accurate update of the client file.

Name				
Indicate if you are	<input type="checkbox"/> Former owner <input type="checkbox"/> New owner	Premier Tech customer number		
Address of the site where Premier Tech's system is installed				
Address	Street	City	Province/State	Postal code/Zip code
Name of new owner				
Mailing address (if different from the site where the system is installed)				
Address	Street	City	Province/State	Postal code/Zip code
Language of correspondence	<input type="checkbox"/> English <input type="checkbox"/> French	Correspondence method	<input type="checkbox"/> Email <input type="checkbox"/> Postal service	
Phone	(office)	Phone	(home)	Email
<input type="checkbox"/> I declare that the residence where a Premier Tech system is installed as indicated at the site address has changed or will change ownership on this date: Date _____				
If you are the FORMER owner				
<input type="checkbox"/> I have provided the owner's manual and the system warranty certificate that is included with this document to the new owners. I informed them that local regulations require that the annual maintenance contract stipulating that maintenance must be performed on the system be renewed every year (no later than 31 December of each year) and that this is essential for them to benefit from the product's warranties and to ensure that the system complies with the regulations.				
Signature _____			Date _____	
If you are the NEW owner				
<input type="checkbox"/> I declare that I have received the manual owner's and the warranty certificate and agree to abide by their conditions. <input type="checkbox"/> I understand that annual maintenance for all treatment systems is required by local regulations and that I must renew my annual maintenance contract every year (no later than 31 December of each year) to benefit from the product's warranties and ensure that the system complies with the regulations.				
Signature _____			Date _____	

